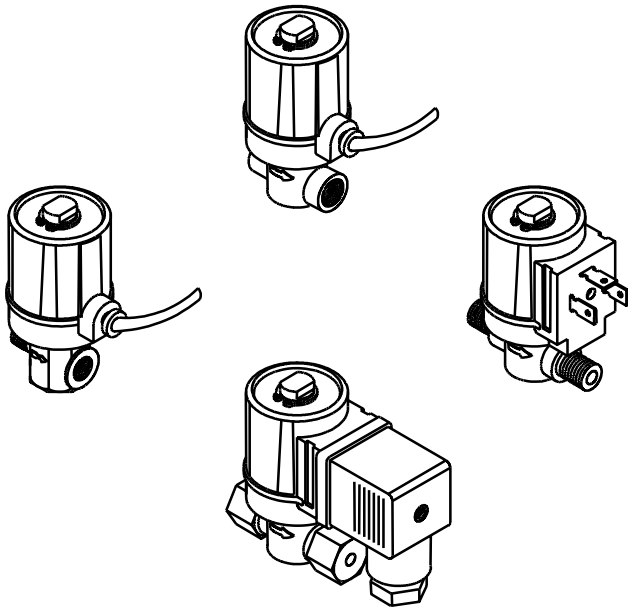


## E7/... SERIES

**SOLENOID VALVES FOR LIGHT OIL,  
OPERATING PRESSURE UP TO 20bar.**



### GENERAL DESCRIPTION

This series solenoid valves are of normally closed type, quick operating, suitable for civil and industrial applications, supplied with alternate or direct current and can be fitted with a wide range of connections which make the assemblage easier and permit to avoid the utilisation of junctions, often onerous and quite unpractical.

Versions marked with "U" in their body type reference, even "TS-S" version, are UL approved.

### TECHNICAL FEATURES

|  |   |
|--|---|
| Supply voltage (1):                      | 230Vac 50Hz   |
| Supply voltage for UL approved versions: | 220Vac 60Hz<br>120Vac 60 Hz                                   |
| Operating pressure range:                | foro ø1,5 0 ÷ 20bar<br>foro ø2 0 ÷ 18bar<br>foro ø4 0 ÷ 2 bar |
| Room temperature:                        | 0° ÷ 60°  |
| Maximum fuel temperature:                | 80°C  |
| Closing and opening time:                | ≤ 1s  |
| Consumption:                             | 10VA  |
| Flow (2):                                | 0.055 m³/h  |
| Weight (2):                              | 230g  |
| Assembling position:                     | all   |
| Body:                                    | die-cast brass  |

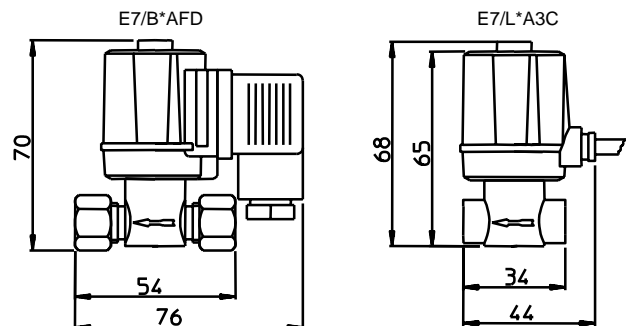
(1) Versions with different supply voltage are available.

(2) These values are indicative, as with the changing of utilised body type, removals from indicated values can occur.





















### APPROVALS

The types E7/L\*A3C and E7/L\*AFD are in accordance with the European standard DIN EN264 (DIN Reg. N°5S215/98)

### OVERALL DIMENSIONS



**AVAILABLE BODY TYPES**
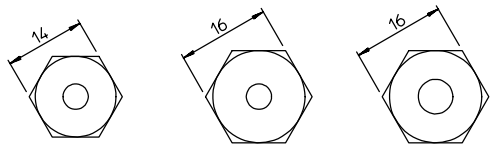
|   |  |   |   |
|---|--|---|---|
| <p align="center"><b>E7/B</b></p>  <p>CONNECTIONS:<br/>Input: G1/4" M<br/>Output : G1/4" M<br/>Orifice diameter: 15 mm<br/>Nut connection:<br/>G1/4" orifice 4 o 6 mm<br/>ogive orifice 4 o 6 mm</p> | <p align="center"><b>E7/B4</b></p>  <p>CONNECTIONS:<br/>Input: G1/4" M<br/>Output : G1/4" M<br/>Orifice diameter: 15 mm<br/>Nut connection:<br/>G1/4" orifice 4 o 6 mm<br/>ogive orifice 4 o 6 mm</p> | <p align="center"><b>E7/BS</b></p>  <p>ATTACCHI:<br/>Ingresso G1/8" F<br/>Uscita : R1/8" M<br/>Foro di passaggio 15 mm</p>  | <p align="center"><b>E7/C</b></p>  <p>CONNECTIONS:<br/>Input: R1/8" M<br/>Output : G1/8" F<br/>Orifice diameter: 15 mm</p>   |
| <p align="center"><b>E7/F</b></p>  <p>CONNECTIONS:<br/>Input: R1/8" M<br/>Output : G1/4" M<br/>Orifice diameter: 15 mm<br/>Nut connection:<br/>G1/4" orifice 4 o 6 mm<br/>ogive orifice 4 o 6 mm</p> | <p align="center"><b>E7/L</b></p>  <p>CONNECTIONS:<br/>Input: G1/8" F<br/>Output : G1/8" F<br/>Orifice diameter: 15 mm</p>  | <p align="center"><b>E7/L4</b></p>  <p>CONNECTIONS:<br/>Input: G1/8" F<br/>Output : G1/8" F<br/>Orifice diameter: 4 mm</p>  | <p align="center"><b>E7/O</b></p>  <p>CONNECTIONS:<br/>Input: G1/8" M<br/>Output : G1/8" M<br/>Orifice diameter: 15 mm<br/>Nut connection:<br/>G1/8" orifice 4 mm<br/>ogive orifice 4 mm</p> |
| <p align="center"><b>E7/R</b></p>  <p>CONNECTIONS:<br/>Input: M8x1 F<br/>Output : G1/4" M<br/>Orifice diameter: 2 mm<br/>Nut connection:<br/>G1/4" orifice 4 o 6 mm<br/>ogive orifice 4 o 6 mm</p>  | <p align="center"><b>E7/T</b></p>  <p>CONNECTIONS:<br/>Input: R1/8" M<br/>Output: G1/8" M<br/>Orifice diameter: 15 mm<br/>Nut connection:<br/>G1/8" orifice 4 mm<br/>ogive orifice 4 mm</p>          | <p align="center"><b>E7/TS</b></p>  <p>CONNECTIONS:<br/>Input: R1/8" M<br/>Output: G1/8" M<br/>Orifice diameter: 15 mm<br/>Nut connection:<br/>G1/8" orifice 4 mm<br/>ogive orifice 4 mm</p>   | <p align="center"><b>E7/L-US</b></p>  <p>CONNECTIONS:<br/>Input: 1/8" NPT F<br/>Output: 1/8" NPT F<br/>Orifice diameter: 15 mm</p>  |
| <p align="center"><b>E7/T-US</b></p>  <p>CONNECTIONS:<br/>Input: 1/8" NPT M<br/>Output: 3/8-24 M<br/>Orifice diameter: 15 mm</p>   | <p align="center"><b>E7/TS-US</b></p>  <p>CONNECTIONS:<br/>Input: 1/8" NPT M<br/>Output: 7/16-20 M<br/>Orifice diameter: 15 mm</p>  | <p align="center"><b>E7/US</b></p>  <p>CONNECTIONS:<br/>Input: 1/8" NPT M<br/>Output: 1/8" NPT F<br/>Orifice diameter: 15 mm</p>  | <p align="center"><b>E7/TS-U</b></p>  <p>CONNECTIONS:<br/>Input: 1/8" NPT M<br/>Output: 1/8" NPT F<br/>Orifice diameter: 15 mm</p>   |
| <p align="center"><b>E7/TS-S</b></p>  <p>CONNECTIONS:<br/>Input: 1/8" NPT M<br/>Output: 3/8-24 M<br/>Orifice diameter: 15 mm</p>   | <p align="center"><b>E7/T-U</b></p>  <p>CONNECTIONS:<br/>Input: 1/8" NPT M<br/>Output: 7/16-20 M<br/>Orifice diameter: 15 mm</p>  |  <p>Nut: G1/8" orifice 4 mm    Nut: G1/4" orifice 4 mm    Nut: G1/4" orifice 6 mm<br/>Ogive orifice 4 mm    Ogive orifice 4 mm    Ogive orifice 6 mm</p>  |   |

## INSTALLATION

- Respect the applicable national and European standards (e.g. EN60335-1) regarding electrical safety.
- Even in the versions without earth conductor the installation must ensure the valve body connection to earth to guarantee adequate protection against the risk of electric shock (EN60335-1).
- Assemble the valve to the installation so that the arrow on the valve body has the same direction as the fuel flow.
- During the assembly of the valve to the installation piping, do not twist on the sheath but on the valve body.
- Make sure that no foreign matters have entered the valve body.
- Always fit a filter to the valve inlet with a mesh section not exceeding 0.5mm.
- Ensure a perfect connection between the valve earth conductor and the earth of the installation.
- Make sure that the max. fuel input pressure never exceeds the value appearing on the label.

## CHECKING AT START

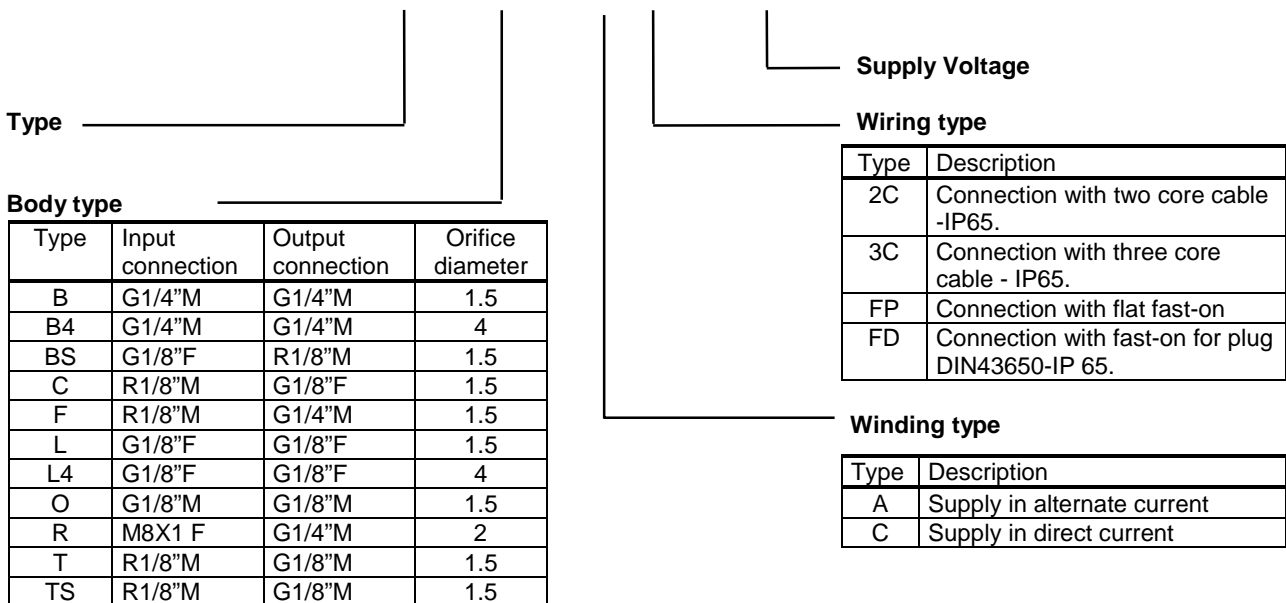
- Check the valve before the first start, after any overhaul or a long period of non-operation of the system. In particular, check the valve seal where the supply piping is connected to the valve; check the valve opening and closing according to the electrical signal received by the solenoid.

## DIRECTIONS FOR THE REPLACEMENT OF THE SOLENOID

- To replace the solenoid, proceed as follows:
- switch off the main switch providing supply voltage to the system;
- remove the stop ring;
- remove the solenoid from the valve sheath;
- insert the new solenoid and proceed in the opposite way to assemble the valve.

## TYPE REFERENCE

**E7 / LS \* A 3C 230/50**



UL APPROVED VERSIONS

**E7 / L-US \* A 2F 120/60**



| Type  | Input connection | Output connection | Orifice diameter |
|-------|------------------|-------------------|------------------|
| L-US  | 1/8" NPT F       | 1/8" NPT F        | 1.5              |
| T-US  | 1/8" NPT M       | 3/8-24 M          | 1.5              |
| TS-US | 1/8" NPT M       | 7/16-20 M         | 1.5              |
| US    | 1/8" NPT M       | 1/8" NPT F        | 1.5              |
| TS-U  | 1/8" NPT M       | 1/8" NPT F        | 1.5              |
| TS-S  | 1/8" NPT M       | 3/8-24 M          | 1.5              |
| T-U   | 1/8" NPT M       | 7/16-20 M         | 1.5              |

**Supply voltage**

| Type   | Description   |
|--------|---------------|
| 120/60 | 120 Vac 60 Hz |
| 230/60 | 230 Vac 60 Hz |

**Wiring type**

| Type | Description                      |
|------|----------------------------------|
| 2F   | Connection with two cable - IP65 |

**Tipo di avvolgimento**

| Type | Description                 |
|------|-----------------------------|
| A    | Supply in alternate current |